

New Stream Triads 2019/20


March 27, 2020

In accordance with the Connection and Use of System Code (CUSC), the Triads for each charging year are calculated and published by National Grid Electricity System Operator using net system demand data (based on the latest available settlement metering) for each half hourly settlement period between November and February inclusive.

The Triads are the three half-hour settlement periods of highest net system demand on the GB electricity transmission system between November and February (inclusive) each year, separated by at least ten clear days. The Triads are used to determine TNUoS demand charges for customers with half hourly meters (see Section 14 of the CUSC).

The Triads for 2019/20 are:

Date	Settlement Period	Net System Demand (MW)
18th November 2019	35	44,308
2nd December 2019	35	44,160
17th December 2019	34	43,546

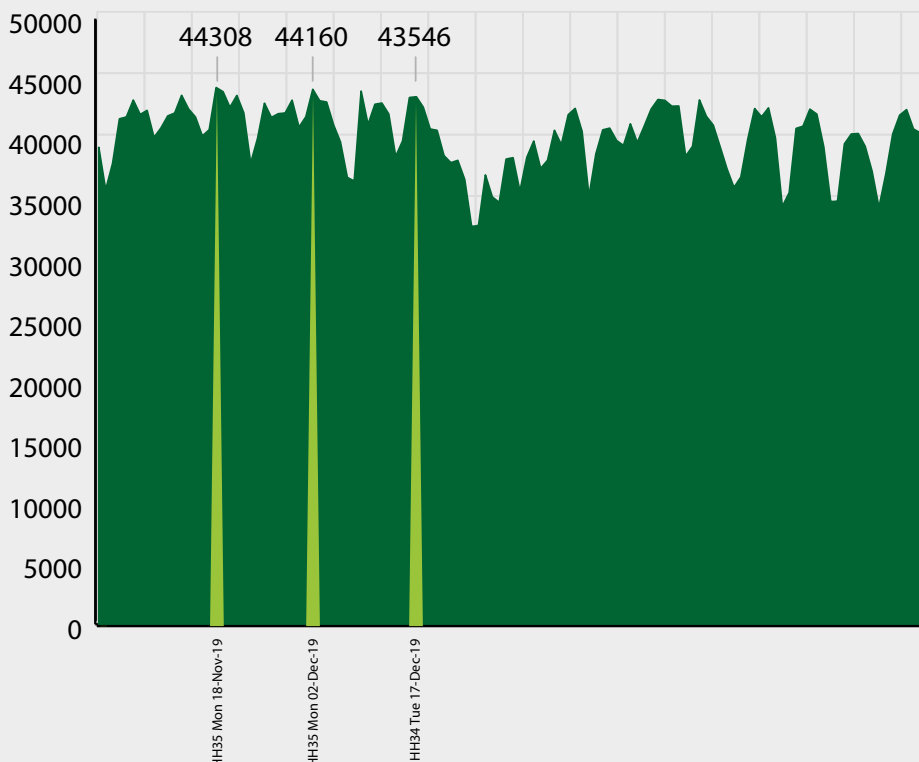

Providing renewable generators PPA and route to market power trading advice since 2008.



NEW STREAM
RENEWABLES

4 Charlecote Mews Staple Gardens
Winchester SO23 8SR

newstreamrenewables.com